


RAYCHEM

FROSTGUARD 240 V

240 V Preassembled Electric Heating Cables for Pipe Freeze Protection Installation Instructions



APPROVALS



HEATING CABLE SELECTION

FrostGuard 240 V (FG2) heating cable selection for pipe freeze protection:

Use the tables to the right to select the correct heating cable. Round up to the next pipe size if your pipe diameter isn't shown.

The charts assume the lowest ambient temperature is -20° F (-29° C), with a minimum of 1/2 in fiberglass insulation or equivalent. For protection to -40° F (-40° C), use 1 inch fiberglass insulation or equivalent fire-resistant insulation.

Add 1 foot to your pipe length for each valve or spigot on your pipe system. If length of cable selected is longer than the pipe, spiral cable evenly along the entire pipe.

DESCRIPTION


nVent RAYCHEM FrostGuard 240 V preassembled electric heating cables are intended for installation on metal or plastic water pipes for freeze protection in commercial locations. FrostGuard 240 V heating cables are available in 6-, 12-, 18-, and 24-foot lengths and each comes complete with a 6-ft cold lead.


KIT CONTENTS

Item	Qty	Description		
1	FrostGuard preassembled heating cable			
3	Wire conne	ectors		

ADDITIONAL MATERIALS REQUIRED

- 1 UL Listed or CSA Certified junction box suitable for wet or dry
- 1 UL Listed or CSA Certified outlet bushing and fitting Cable ties or glass-cloth tape Thermal pipe insulation





Add 1 foot to your pipe length for each valve or spigot on your pipe system. If cable selected is longer than the pipe, spiral it evenly along the entire pipe.

Important

All thermal and design information provided here is based upon a "standard installation": heating cable fastened to a pipe and thermally insulated. For any other method of installation or application, consult nVent at (800) 542-8936 for design assistance to ensure proper design of electrical distribution and acceptable pipe temperatures.

FIRE AND SHOCK HAZARD. This product is an electrical device that must be installed correctly to ensure proper operation and to prevent shock or fire. Read these important warnings and carefully follow all the installation instructions.


- To minimize the danger of fire from sustained electrical arcing if the heating cable is damaged or improperly installed, and to comply with the
- requirements of nVent, agency certifications, and the National Electrical Code, ground-fault equipment protection must be used on each heating cable branch circuit. Arcing may not be stopped by conventional circuit protection.
- Use only fire-resistant insulation materials such as fiberglass wrap.
- · Do not damage the heating cable and cord
- connector. Remove any damaged cables from service immediately.
- Do not use any wire or metal clamps to attach the cable to the pipe. Use tape (1/2 inch wide to 1 inch wide) or plastic cable ties.
- Leave these installation instructions with the user for future reference.


GENERAL REQUIREMENTS:


- FrostGuard heating cables are not intended for use inside any pipes, for freeze protection of liquids other than water, or for use in classified hazardous locations.
- FrostGuard heating cables may be used on metal and plastic water pipes but not on flexible vinyl tubing (such as garden hoses).
- Install with a minimum of 1/2 inch fire-resistant thermal insulation. Weatherproof the insulation if it might get wet.
- Never use on any pipes that may exceed 150°F (65°C).

GENERAL INSTRUCTIONS:

- Install only in accessible locations; do not install behind walls or where the cable would be hidden.
- Do not run the heating cable through walls, ceilings, or floors.
- Connect only to junction boxes that have been installed in accordance with all prevailing national and local codes and standards and are protected from rain and other water.
- Prior to installing the cable, remove any sharp surfaces on the pipe that might damage the heating cable.
- · Follow the specific installation instructions that begin below.
- · Follow the maintenance guidelines on page 3.

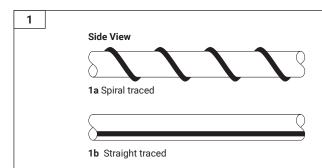





the end of the pipe, double it back along the pipe and cover it




1c Two cables in 4 and 8 o'clock positions

as required.




1d Three cables in 4, 8, and 10 o'clock positions

- If two FrostGuard cables are used, position them in the 4 o'clock and 8 o'clock positions (Figure 1c).
- If three FrostGuard cables are used, position them in the 4, 8, and 10 (or 2) o'clock positions (Figure 1d).

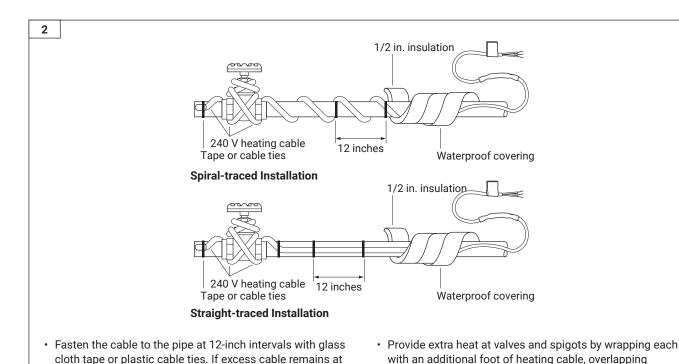

with insulation.

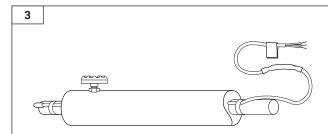


Thermal insulation

- · Before installing the thermal insulation, check to see that the heating cable is free from mechanical damage (such as from cuts or clamps) and thermal damage (such as from solder or overheating).
- · Using a megohmmeter, test each circuit according to the "Cable testing and maintenance" instructions below, both prior to and after installing the thermal insulation.

Note: A reliable FrostGuard system depends on properly installed and dry, weatherproofed thermal insulation.

- Ensure that at least 1/2 inch of fiberglass or equivalent thermal insulation is used and that all pipework, including valves, joints, and wall penetrations, has been fully insulated. To minimize the potential for mechanical damage after installation, install the insulation on the pipework as soon as possible.
- Be sure the FrostGuard 240 V label is visible on the outside of the thermal insulation.

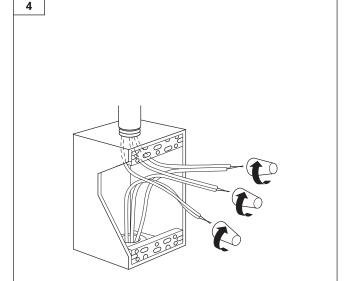

Connecting the FrostGuard cable to power

Using the three wire connectors included in the kit, connect the black and white cold leads to both phase wires and the green cold lead to ground. Provide suitable UL Listed and CSA Certified junction box and outlet bushing and fitting.

CABLE TESTING AND MAINTENANCE

Using a 2500-Vdc megohmmeter, check the insulation resistance between the lead wires and ground wire during installation. Minimum reading should be 1000 megohms.

The installer should record the original values for each circuit. Subsequent readings taken during regular maintenance schedules should be compared to the original value.

If the readings should fall below 1000 megohms, replace the FrostGuard cable with a new unit. Do not attempt to repair the unit.

MARNING: Fire and Shock Hazard. Damaged heating cable can cause electrical shock, arcing, or fire. Do not attempt to repair or energize damaged heating cable. Remove it at once and replace with a new length.

Product Specifications					
	FG2-6L	FG2-12L	FG2-18L	FG2-24L	
Cable length (ft/m)	6 (1.8)	12 (3.7)	18 (5.5)	24 (7.3)	
Min. thermal output on a pipe at 40°F/4°C (watts)	30	60	90	120	
Min. thermal output on a pipe at 0°F/-18°C (watts)	46	92	138	184	
Max. current draw on a pipe at 40°F/4°C (amps)	0.21	0.43	0.64	0.85	
Max. current draw on a pipe at 0°F/-18°C (amps)	0.32	0.64	0.96	1.28	
General Specifications for all FG2 Products					
Maximum cable width (inch/mm)	0.45 (11.4)				
Maximum cable thickness (inch/mm)	0.24 (6.1)				
Heating cable bus wire gauge (AWG)	16				
Voltage rating (Vac)	208-240				
Circuit breaker size	15 A max.				
Cold lead length (ft/m)	6 (1.83)	6 (1.83)			
Maximum exposure temperature	150°F (65°C)	150°F (65°C)			
Minimum installation temperature	5°F (−15°C)				
Minimum bend radius (inch/mm)	5/8 (16)				
Electrical classification	Nonhazardous	Nonhazardous areas only			
Exposure to chemicals	None				

North America

Tel: +1.800.545.6258 Fax: +1.800.527.5703 thermal.info@nvent.com



nVent.com